



Class I, Div I and 2 Groups B, C, D
Class II, Div I and 2 Groups E, F, G
Class III NEMA 3, 4
Moisture resistant
Dust resistant

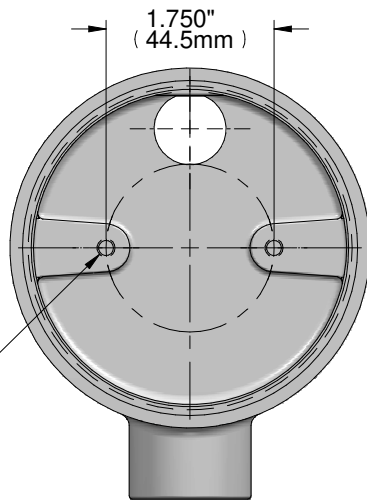

HOLE PATTERN FOR MOUNTING
TERMINAL PLATE/ RAIL

10-32 TAPPED
2 PLACES

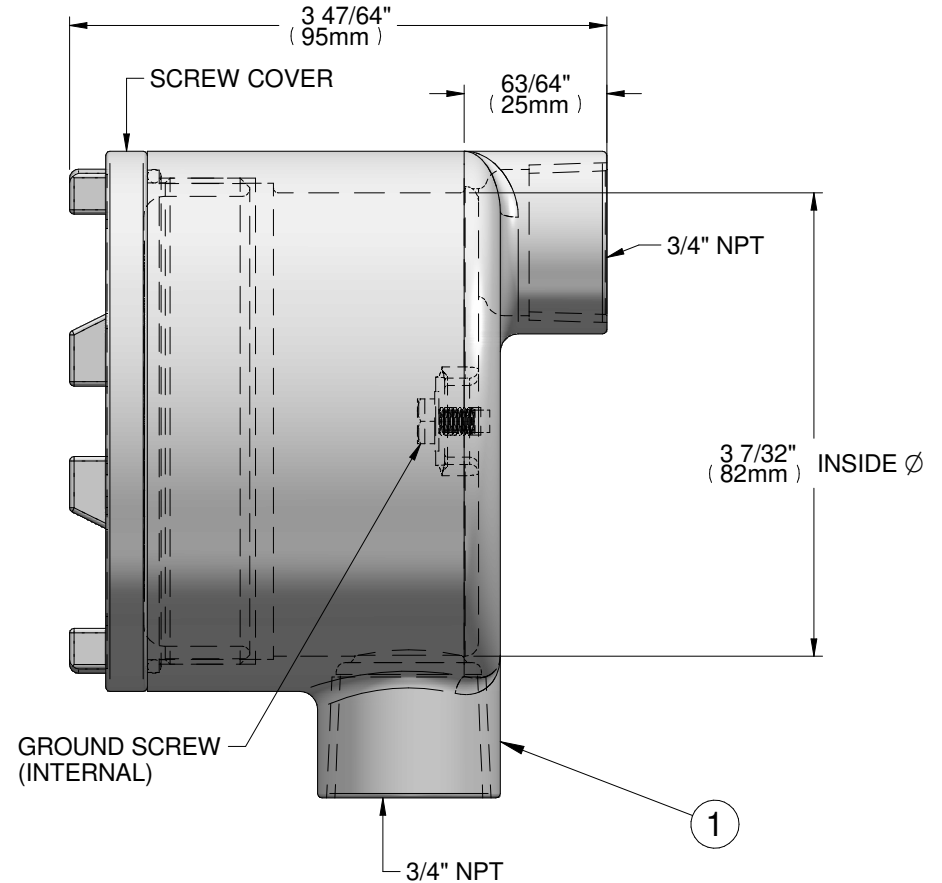

JMS PART #
6I

JMS SOUTHEAST INCORPORATED CERTIFIES THIS DRAWING IS IN ACCORDANCE WITH JMS SOUTHEAST INCORPORATED ENGINEERING SPECIFICATIONS AND ACCURATELY REPRESENTS THE EQUIPMENT FURNISHED. THIS DRAWING IS THE SOLE PROPERTY OF JMS SE, AND MUST BE RETURNED UPON DEMAND IT MAY NOT BE REPRODUCED NOR THE INFORMATION CONTAINED THEREIN USED WITHOUT THE WRITTEN PERMISSION OF JMS SOUTHEAST INCORPORATED

Company Name:

JMS-SE HEADS

**COLD END TERMINATION
SELECTION = SI**

Drawing #:
18262-M

TOLERANCE TABLE:
PROBE (L): 0-48" ±1/8"
48"-144" ±1/4"
144"+ -1" / +2"
WIRE (L): <24" -1/2" / +1"
>24" -1/2" / +2"
PROT. TUBE (P&U): ±1/4"
FRACTIONAL DIM: ±1/8"
DECIMAL DIM:
X.X ± 0.10"
X.XX ± 0.010"
X.XXX ± 0.005"
UNLESS STATED OTHERWISE

Approvals	Initials	Date
Drafting		
Engineering		
Second		



JMS SOUTHEAST, INC.
Temperature Measurement
105 Temperature Lane
Statesville, North Carolina 28677
Phone: (704) 873-1835
Fax: (704) 878-6166
www.jms-se.com
Email: sensors@jms-se.com

REV. 4-10-2009

#	DESCRIPTION
1	HEAD, MALLEABLE IRON, ALUM. COVER, 3/4" X 3/4" FNPT, CSA CL I,II GP B,C,D,E,F,G, NEMA 3,4